

**CLIENT: POLYCOAT PRODUCTS**  
14722 Spring Avenue  
Santa Fe Springs, CA 90670

<b>Test Report No: RJ4296-1</b>	<b>Date: October 13, 2015</b>
---------------------------------	-------------------------------

**SAMPLE ID:** The test samples are identified as: Polyeuro MH 751FR Coating.

**SAMPLING DETAIL:** Test samples were submitted to the laboratory directly by the client. No special sampling conditions or sample preparation were observed by QAI.

**DATE OF RECEIPT:** Samples were received at QAI on October 09, 2015.

**TESTING PERIOD:** October 13, 2015.

**AUTHORIZATION:** Testing authorized by Hemant Prajapati. Proposal No. DM-2015-092502 dated and signed on September 25, 2015.

**TEST REQUESTED:** Perform standard flame spread and smoke density developed classification tests on the sample supplied by the Client in accordance with ASTM Designation E84-15a, "Standard Method of Test for Surface Burning Characteristics of Building Materials". The foregoing test procedure is comparable to UL 723, ANSI/NFPA No. 255, and UBC No. 8-1.

<b>TEST RESULTS:</b>	<b><u>Flame Spread</u></b>	<b><u>Smoke Developed</u></b>
	25	250

Detailed test results are presented in the subsequent pages of this report.


**CONCLUSION:** The submitted material meets the requirements for a "Class A" Flame Spread. See classification requirements on page 2.

**Prepared By**



Brian Ortega  
Test Technician

**Signed for and on behalf of  
QAI Laboratories, Inc.**



Greg Banasky  
Senior Technician

**PREPARATION:** The sample material was submitted in three pieces 22" wide by 8' feet long conforming to test chamber dimensions.

**CONDITIONING:** The test specimen was conditioned to a constant weight at a temperature of  $73.4 \pm 5^{\circ}$  F ( $23 \pm 2.8^{\circ}$  C) and a relative humidity of  $50 \pm 5$  %.

**CEMENT BOARD PLACEMENT:** The 1/4" cement boards were placed between the test specimen and the chamber lid.

**E 84 TEST DATA SHEET:**

**CLIENT:** Polycoat Products    **DATE:** 10/13//2015

**SAMPLE:** Polyeuro MH 751FR Coating.

**IGNITION:** 27 seconds.

**FLAME FRONT:** 6 feet maximum.

**TIME TO MAXIMUM SPREAD:** 3 minutes, 53 seconds.

**TEST DURATION:** 10 minutes.

**CALCULATION:**  $53.18 \times .515 = 27.39$

**SUMMARY: FLAME SPREAD:** 25                    **SMOKE DEVELOPED:** 250    (257.67)



**SUMMARY OF ASTM E84 RESULTS:** Because of the possible variations in reproducibility, the results are adjusted to the nearest figure divisible by 5. Smoke Density values over 200 are rounded to the nearest figure divisible by 50.

In order to obtain the Flame Spread Classification, the above results should be compared to the following table:

<u>NFPA CLASS</u>	<u>IBC CLASS</u>	<u>FLAME SPREAD</u>	<u>SMOKE DEVELOPED</u>
A	A	0 through 25	Less than or equal to 450
B	B	26 through 75	Less than or equal to 450
C	C	76 through 200	Less than or equal to 450

**BUILDING CODES CITED:**

1. National Fire Protection Association, ANSI/NFPA No. 101, "Life Safety Code".
2. International Building Code, Chapter 8, Interior Finishes, Section 803.

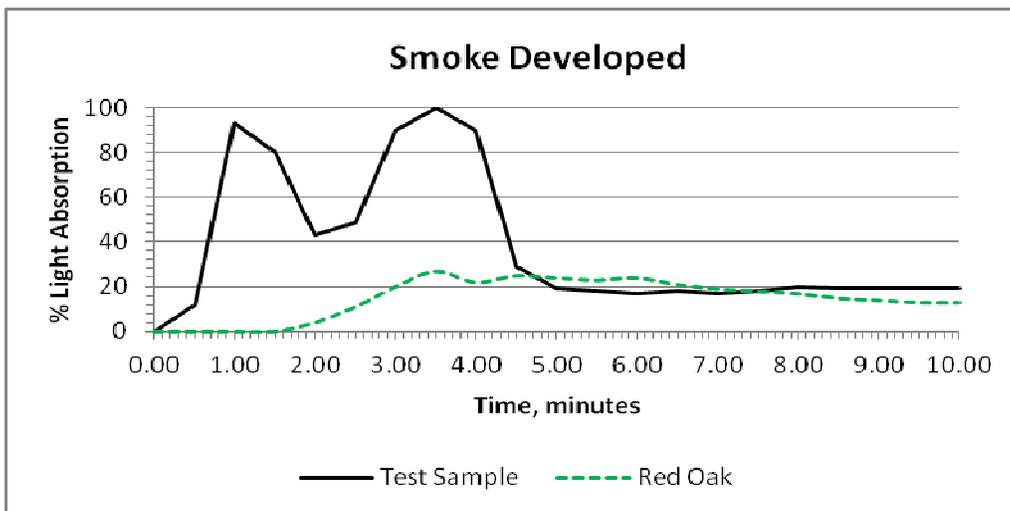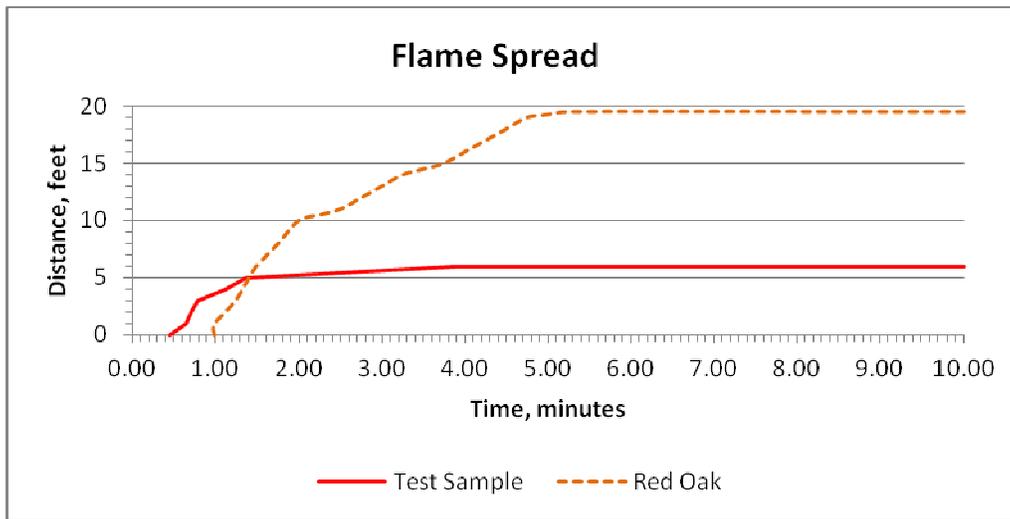

End of Report